

Job Name:	Date:
System Reference:	



OUTDOOR VRF HEAT PUMP SYSTEM

**UNIT OPTION**

- Standard Model.....PUHY-P120YLMU-A
- Seacoast (BS) Model.....PUHY-P120YLMU-A-BS

**ACCESSORIES**

- Joint Kit.....for details see Pipe Accessories Submittal
- Low Ambient Kit .....for details see Low Ambient Kit Submittal
- Snow/Hail Guards Kit.....for details see Snow/Hail Guards Kit Submittal
- Base Pan Heater Kit.....for details see Base Pan Heater Kit Submittal

Specifications		Model Name
Unit Type		PUHY-P120YLMU-A (-BS)
Nominal Cooling Capacity (460V)	Btu/h	120,000
Nominal Heating Capacity (460V)	Btu/h	135,000
Operating Temperature Range *1	Cooling (Outdoor) *2	23~126° F (-5~52° C) DB
	Heating (Outdoor)	-13~60° F (-25~15.5° C) WB
External Dimensions (H x W x D)	In. (mm)	64-31/32 x 68-29/32 x 29-5/32 (1,650 x 1,750 x 740)
Net Weight	Lbs. (kg)	706 (320)
External Finish		Pre-coated galvanized steel sheet
Electrical Power Requirements	Voltage, Phase, Hertz	460V, 3-Phase, 60Hz
Minimum Circuit Ampacity (MCA)	A	19
Maximum Overcurrent Protection (MOP)	A	30
<i>Piping Diameter (Brazed)</i>		
From ODU to First Joint or Header (In. / mm)	Liquid (High Pressure)	3/8 (9.52)
	Gas (Low Pressure)	[1/2" (12.7), if length from ODU to farthest IDU is >= 131' {40m}] 1-1/8 (28.58)
Max. Total Refrigerant Line Length	Ft.	3,280
Max. Refrigerant Line Length (Between ODU & IDU)	Ft.	541
Max. Control Wiring Length	Ft.	1,640
Indoor Unit	Total Capacity	50~130% of outdoor unit capacity
	Model / Quantity	P06~P96/1~26
Sound Pressure Levels	dB(A)	60.0
<i>Fan</i>		
Type x Quantity		Propeller fan x 2
Airflow Rate	CFM	11,300
External Static Pressure	In. WG	Selectable; 0, 0.12 or 0.24"WG; factory set to 0"W.G.
Compressor Operating Range		15% to 100%
Compressor Type x Quantity		Inverter scroll hermetic compressor x 1
Refrigerant		R410A; 26 lbs. + 1 oz. (11.8 kg)
Protection Devices	High Pressure	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter Circuit (Comp. / Fan)	Over-current protection
AHRI Ratings (Ducted/Non-Ducted)	EER	13.2 / 14.9
	IEER	21.9 / 25.3
	COP	3.71 / 4.17

**NOTES:**

- \*1. When applying product below -4° F, consult your design engineer for cold climate application best practices, including the use of a backup source for heating.
- \*2. For details on extended cooling operation range down to -10° F DB, see Low Ambient Kit Submittal.

# Model: PUHY-P120YLMU-A (-BS) – DIMENSIONS

Unit : mm (in.)


Note1. Please refer to the engineering manual for information regarding necessary spacing around the unit and foundation work. Outdoor unit must be mounted at least 12" off the ground or 12" above the highest average snow depth, whichever is greater.  
2. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248 °F).

Connecting pipe specifications

Model	Refrigerant pipe		Diameter	
	Liquid	Gas	Liquid	Gas
PUHY-P120YLMU	ø9.52 Braze (3/8)ø12.7 (ø12.7 Braze) (1/2)ø11.3*4	ø26.58 Braze (1-1/8)ø11	ø12.7 (1/2)	ø28.58 (1-1/8)
PUHY-P144YLMU	ø12.7 Braze (1/2)ø11			
PUHY-P168YLMU	ø15.88 Braze (5/8)ø12			

\*1 Expand the on-site piping and connect to the refrigerant service valve piping.  
\*2 Use the pipe joint(field supply) and connect to the refrigerant service valve piping.  
\*3 Indicates dimensions and connection specifications in the case the unit is used in combination with other outdoor units.  
\*4 Furthest piping length (OU from LU) ≥ 40m(131ft)

NO	Usage	Specifications
①	For pipes	Front through hole 140 x 77 Knockout hole (5-9/16) (3-1/16)
②		Bottom through hole 150 x 94 Knockout hole (5-15/16) (3-3/4)
③	For wires	Front through hole ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
④		Front through hole ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
⑤		Bottom through hole ø65 Knockout hole (2-9/16)
⑥		Bottom through hole ø52 Knockout hole (2-1/16)
⑦	For transmission cables	Front through hole ø34 Knockout hole (1-3/8)

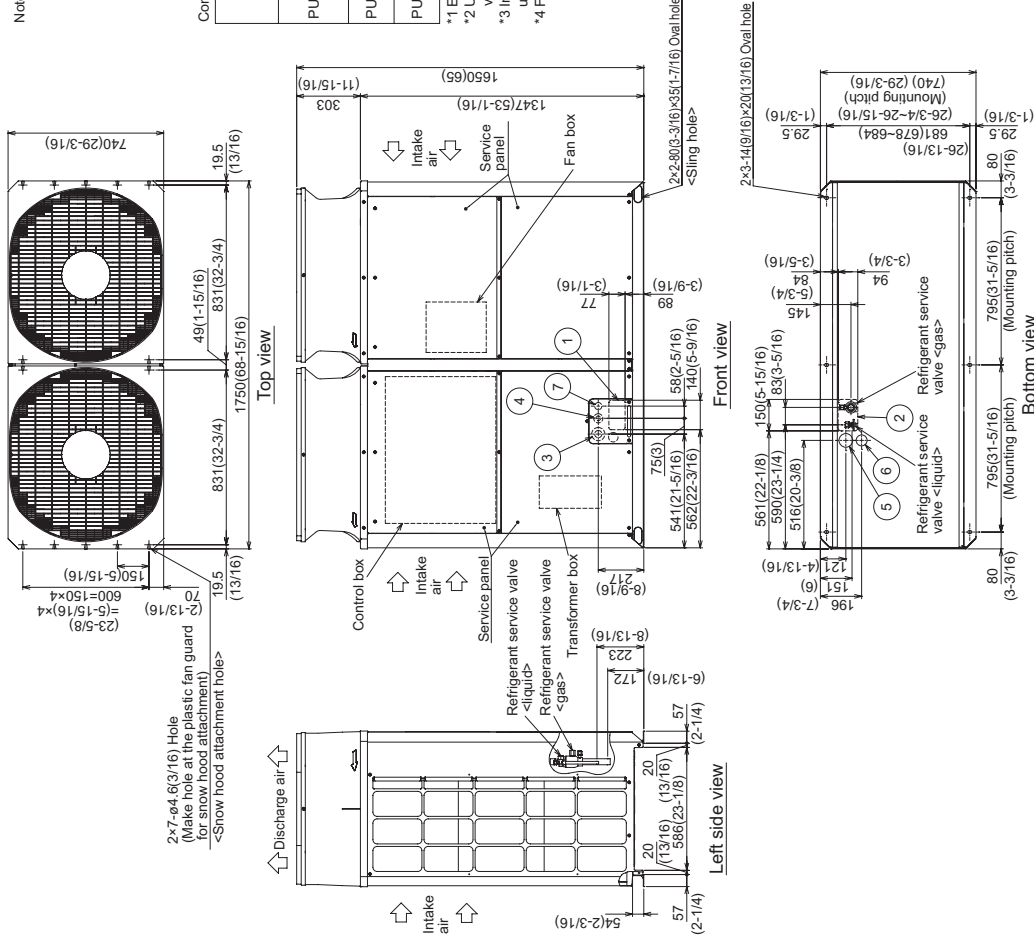

**NOTES:**

**SEACOAST PROTECTION**

- Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
- Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
- Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.



COOLING & HEATING

1340 Satellite Boulevard, Suwanee, GA 30024  
Toll Free: 800-433-4822 www.mehvac.com

